



BURIAL DEPTHS FOR YARD PIPING AND ELECTRICAL LINES


City of Upland Building and Safety Division / 460 N Euclid Ave. Upland, CA 91786 / 909 931-4110

NOTE:

- These burial depths apply outside of the buildings with private property subject to the following provisions.
- 1. Not applicable to utility companies (gas and electric) lines.
- 2. May be laid in the same trench without horizontal separation except as noted for sewer and water lines.
- 3. Does not apply to automatic sprinkler system lines beyond control valves.

SYMBOLS:

- ⊙ Conduit
- Pipe
- ⊖ Alternate Location
- Direct Burial Cable

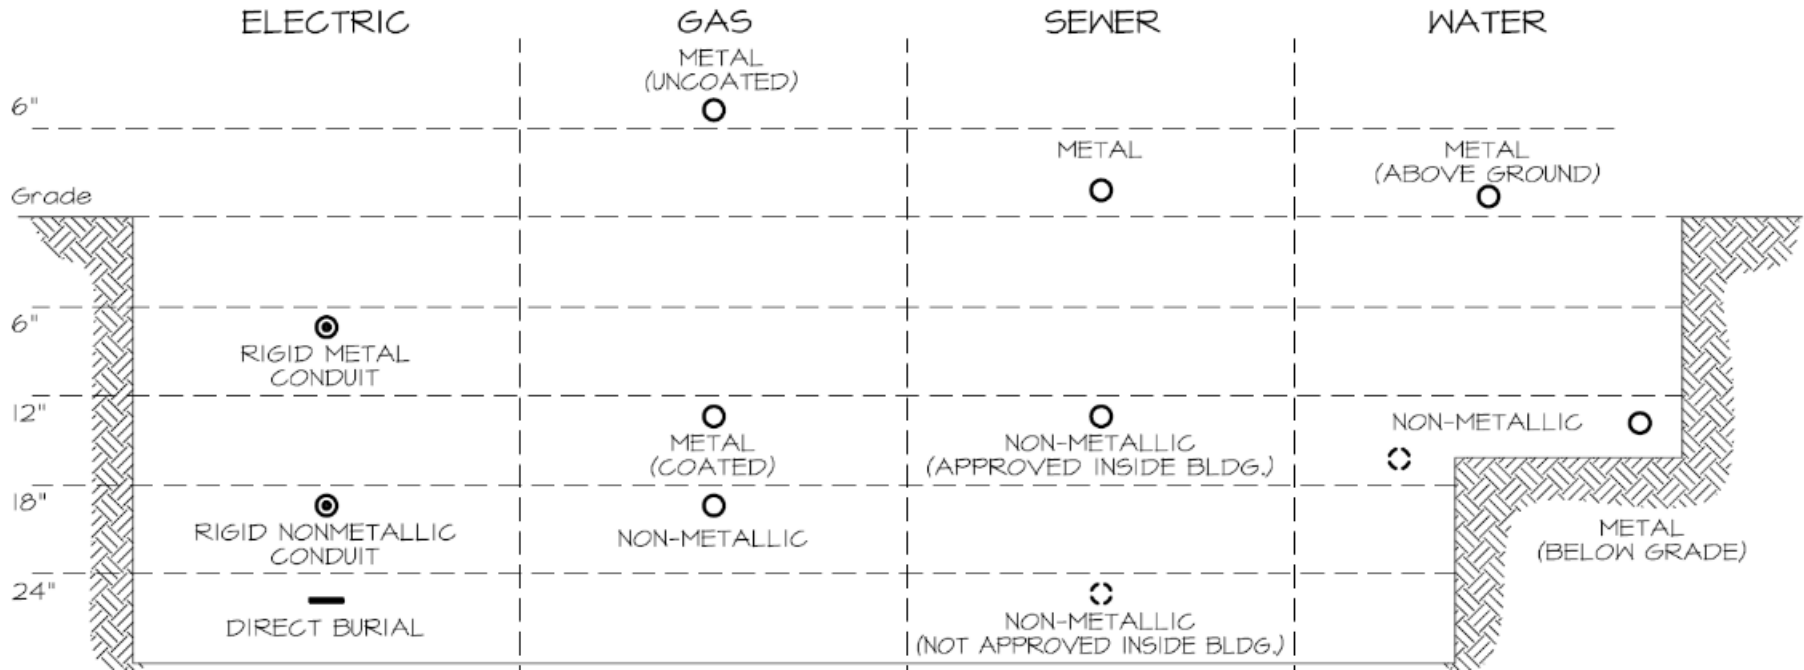

UPC 2000 Sec. 720
Metal –
 At or above grade, or 12” minimum
 below grade
Nonmetallic –
 12” minimum (plastic).

UPC 2000 Sec. 720
Metal –
 At or above grade, or 12” minimum
 below grade
Nonmetallic –
 12” minimum (plastic).

UPC 2000 Sec. 720
Metal –
 No burial requirement
 (recommended 12” to protect from
 mechanical damage and freezing).
Nonmetallic –
 (a) Pipe approved inside building -
 12” minimum.
 (b) Pipe approved inside building –
 sewer to be 12” below water line
 with water pipe 12” to one side
 on a solid shelf – total depth 24”,
 and 12” apart horizontally
 minimum.

UPC 2000 Sec. 720
Metal –
 At or above grade, or 12” minimum
 below grade
Nonmetallic –
 12” minimum (plastic).