




TENTS REQUIREMENTS WITH AND WITHOUT SIDEWALL

Code Requirements:

- Upland Fire District requirements are in accordance with the 2010 California Fire & Building code, Chapter 24.
- 3103.1.1 Permit required. Temporary structures that cover an area in excess of 120 square feet 11.16 m², including connecting areas or spaces with a common means of egress or entrance which are used or intended to be used for the gathering together of 10 or more persons, shall not be erected, operated or maintained for any purpose without obtaining a permit from the building official.
- For projects meeting the above criteria, the Fire District requires the submittal of a site plan showing the actual location of the tent(s) in proximity to hazards. Additional requirements, such as fire extinguisher placement, occupant load, and exit signs will be addressed during the plan review process.

SAMPLE SITE PLAN

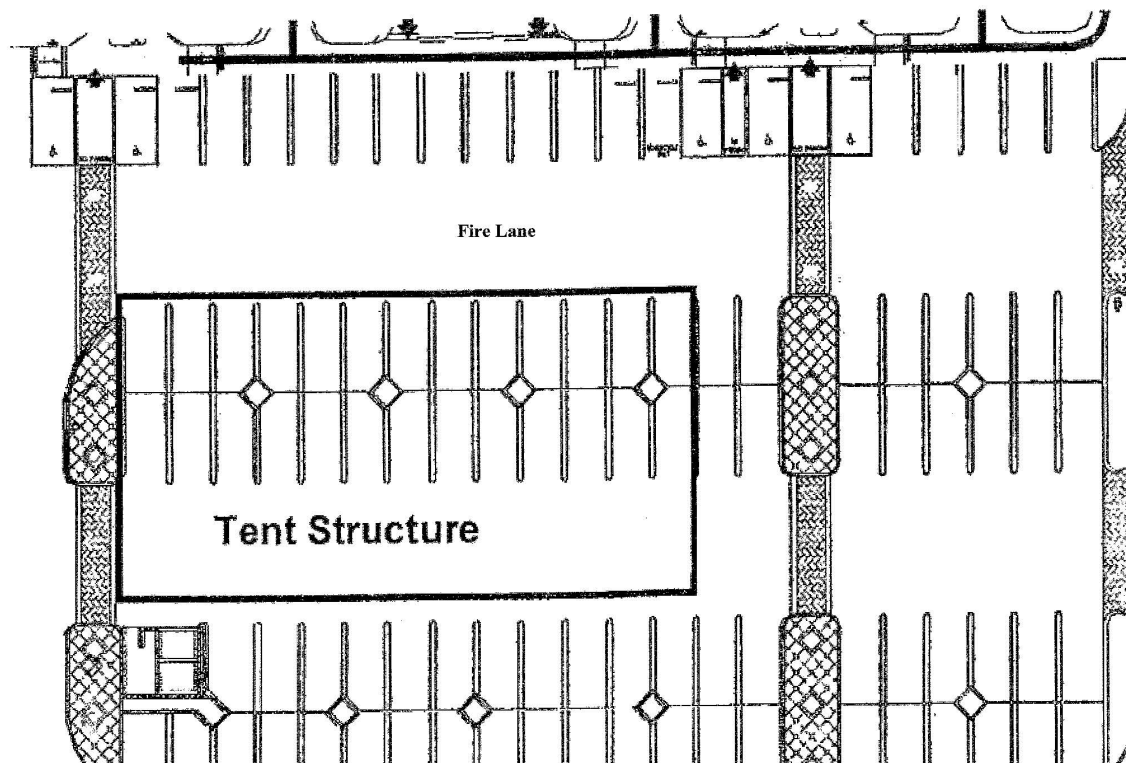





TENTS REQUIREMENTS WITH AND WITHOUT SIDEWALL

Structural Requirements:

- Spacing of anchorage guy rope must be no more than 10 ft. o.c.
- Guy rope must be at least 3/4" dia. wire rope cable.
- The side pole shall have (4) 1" dia. x 4 ft long rods into the ground. See Diagram (A)
- Guy rope stake must have a minimum of (2) 1" dia. x 4 ft long rods. See Diagram (B)

Galvanized steel
Side post & Base
Plate

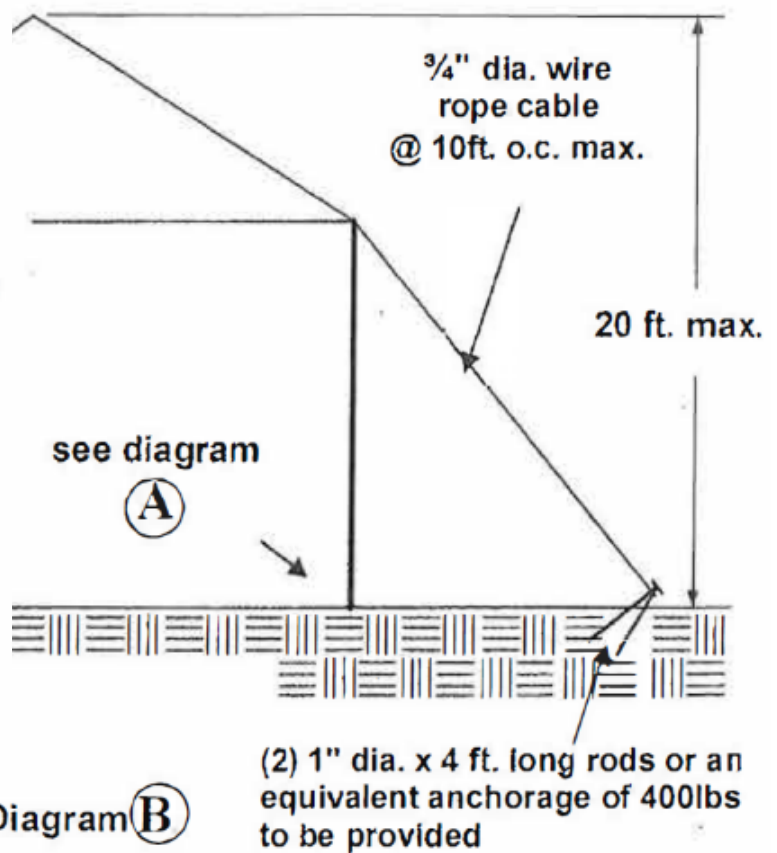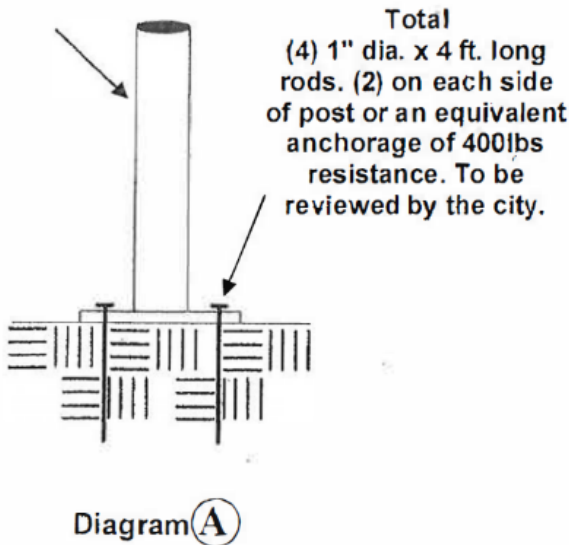

Special Notes:

Engineering design and details stamped and wet signed by an engineer are required when:

- All Tents that cannot comply with the above prescriptive requirements.
- Bail Ring tents and other tent structures with dimensions greater than 40 ft. x 60 ft.
- Heights greater than 20ft.

Usage of previous year's calculations and design must be approved by the engineer who created the design.



TENTS REQUIREMENTS WITH AND WITHOUT SIDEWALL

California Fire Code 2022

3101.1 Scope

Tents, temporary stage canopies and membrane structures shall comply with this chapter. The provisions of Section 3103 are applicable only to temporary tents and membrane structures. The provisions of Section 3104 are applicable to temporary and permanent tents and membrane structures. Other temporary structures shall comply with the California Building Code.

These building standards govern the use of tents, awnings or other fabric enclosures, including membrane (air-supported and air-inflated) structures and places of assemblage, in or under which 10 or more persons may gather for any lawful purpose.

Exceptions:

1. Tents, awnings or other fabric enclosures used to cover or enclose private swimming pools and similar facilities on the premises of private one- and two-family dwellings.
2. Tents used to conduct committal services on the ground of a cemetery.
3. Tents, awnings or other fabric enclosures erected and used within a sound stage, or other similar structural enclosure which is equipped with an overhead automatic sprinkler system.
4. Tensioned membrane roof materials supported by rigid frames or installed on a mast and cable system provided such structures conform to the requirements of one of the types of construction as described in these regulations.
5. Fabric structures which are part of mobile homes, recreational vehicles, or commercial coaches governed by the provisions of Division 13, Part 2, Health and Safety Code (Department of Housing and Community Development).

[California Code of Regulations, Title 19, Division 1, §303.(a) and (b)] Scope.

- a. The provisions of California Code of Regulations, Title 19, Division 1, Chapter 2 apply to the sale, offering for sale, manufacture for sale, rental and use of tents within this state.
- b. For building standards relating to tents and membrane structures, see California Code of Regulations, Title 24, Part 9.