MASONRY GARDEN WALL

WALL AT CENTER OF FOOTING

Revised:	Drawing No.
Approved:	1
Date 3-24-14	page 1 of 7

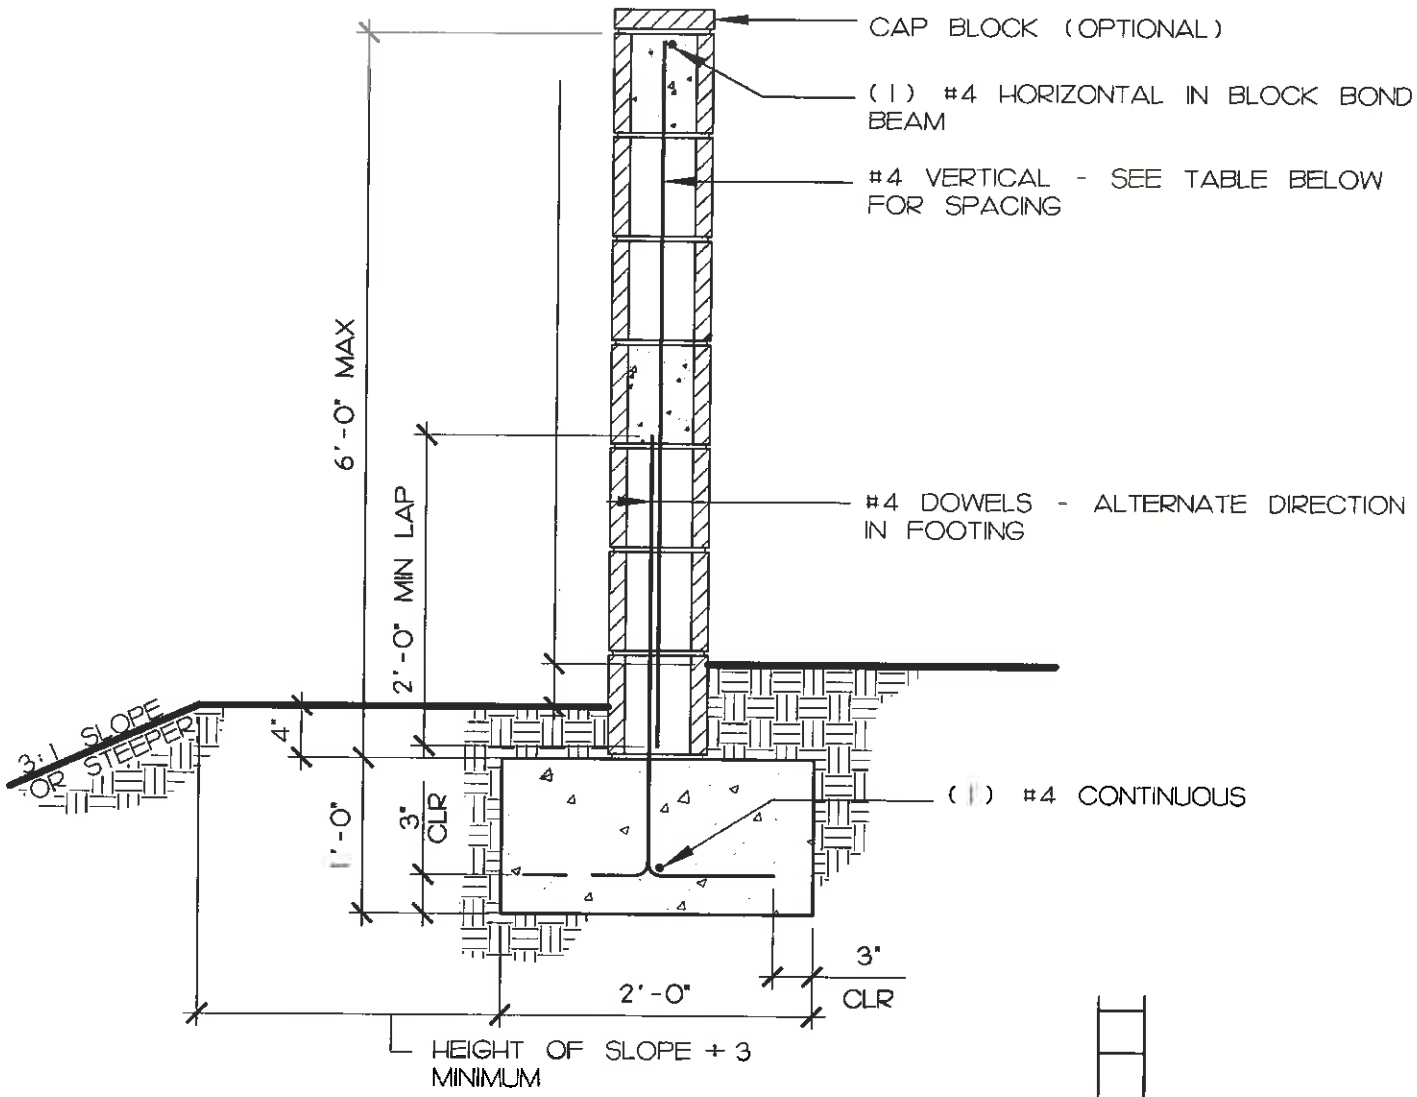

SEE PAGE 7 FOR INSPECTION REQUIRMENTS, CONSTRUCTION REQUIREMENTS, MATERIALS, SPECIFICATIONS AND DETAILS

WALL SCHEDULE

MASONRY THICKNESS	6"	8"
VERTICAL REBAR SPACING	32" O.C.	40" O.C.

MASONRY GARDEN WALL

WALL AT EDGE OF FOOTING

Revised:	Drawing No.
Approved:	2
Date 3-24-14	page 2 of 7

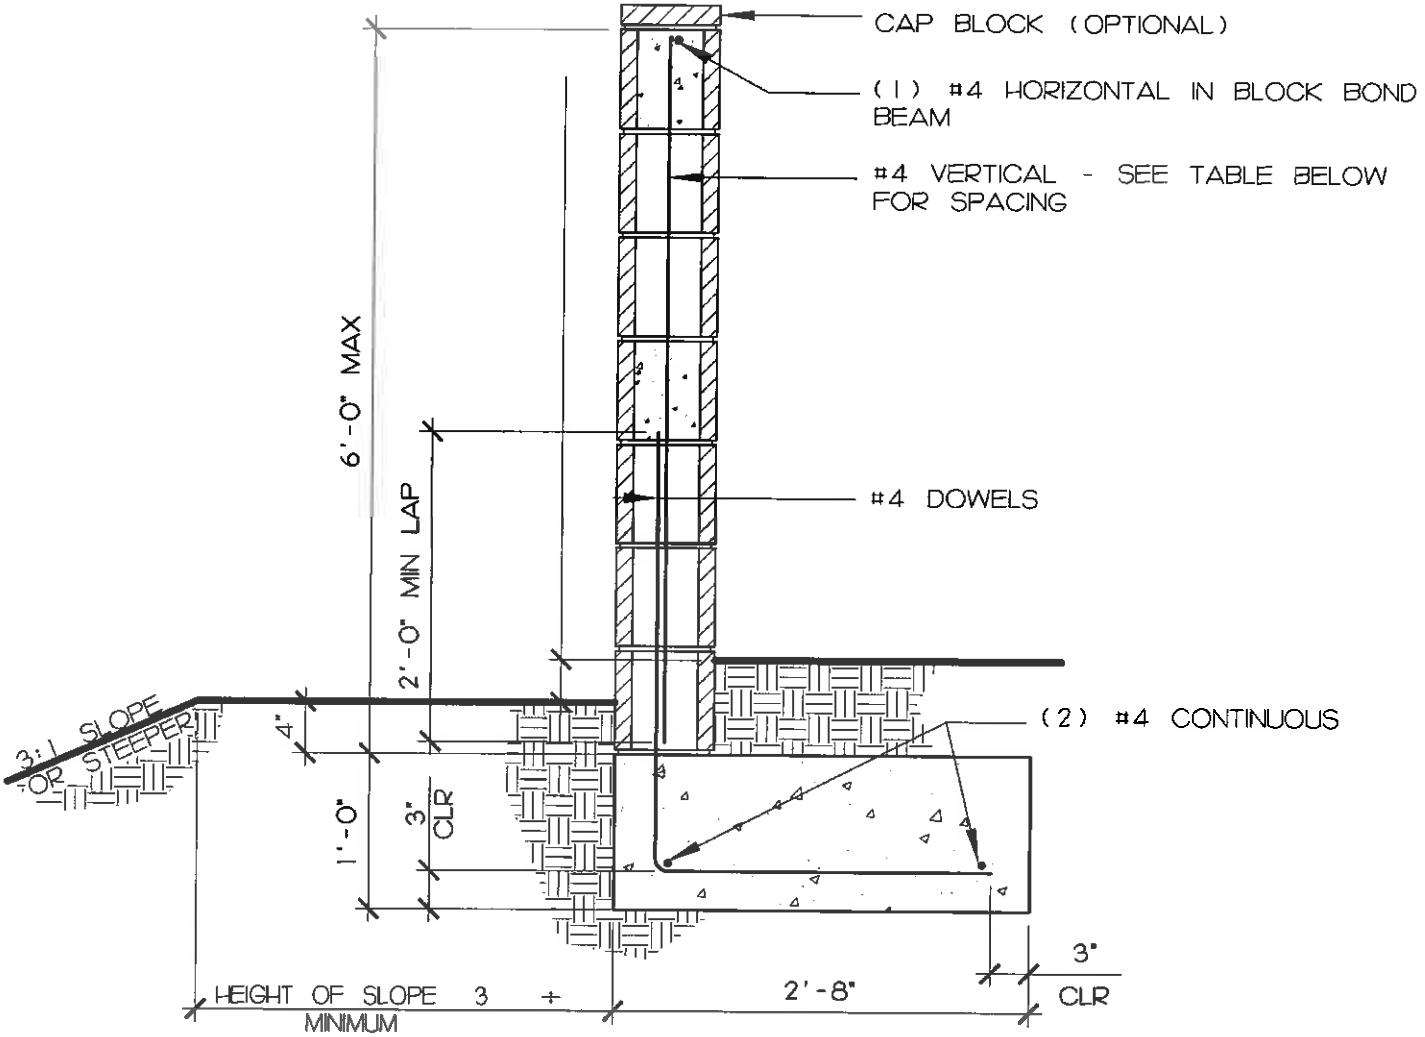

SEE PAGE 7 FOR INSPECTION REQUIRMENTS, CONSTRUCTION REQUIRMENTS, MATERIALS, SPECIFICATIONS AND DETAILS

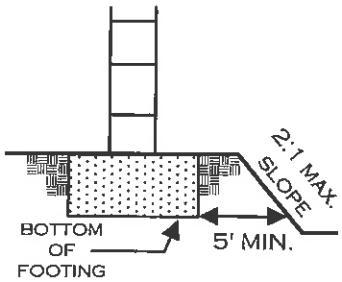

WALL SCHEDULE

MASONRY THICKNESS	6"	8"
VERTICAL REBAR SPACING	32" O.C.	40" O.C.

MASONRY GARDEN WALL

POLE TYPE FOOTINGS

Revised:	Drawing No.
Approved:	3
Date 3-24-14	page 3 of 7

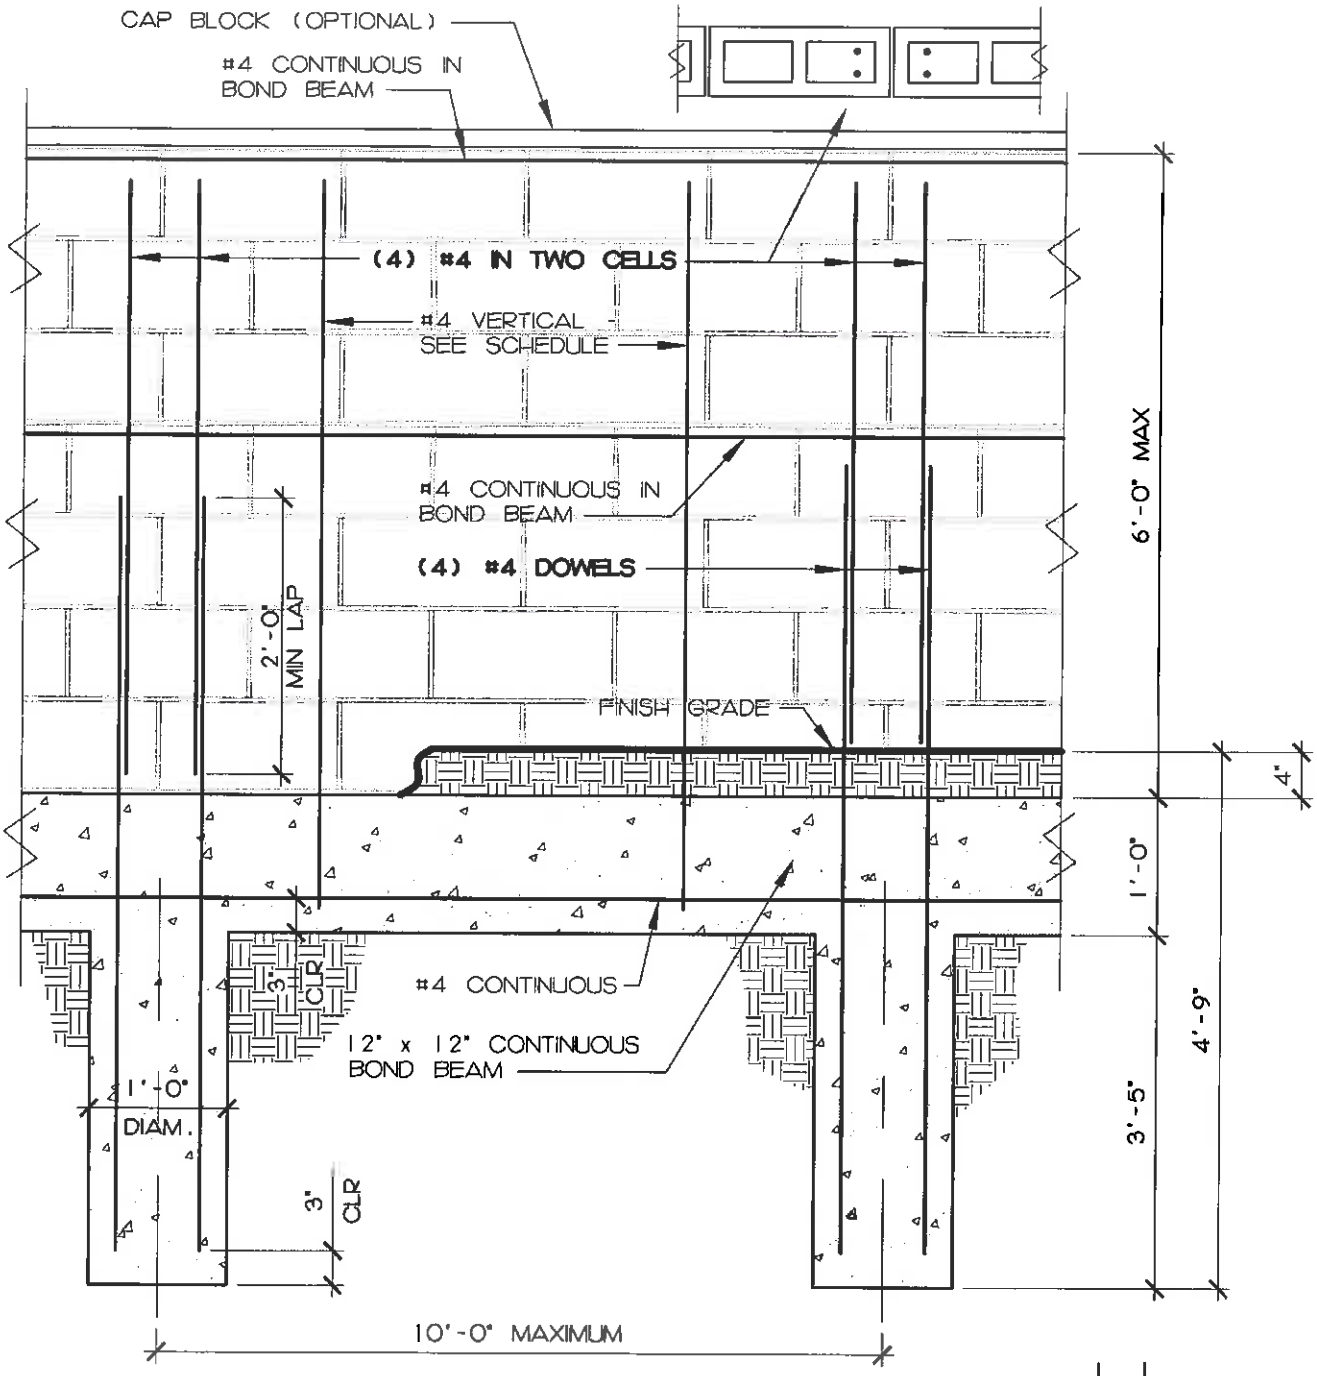

SEE PAGE 7 FOR INSPECTION REQUIRMENTS, CONSTRUCTION REQUIRMENTS, MATERIALS, SPECIFICATIONS AND DETAILS

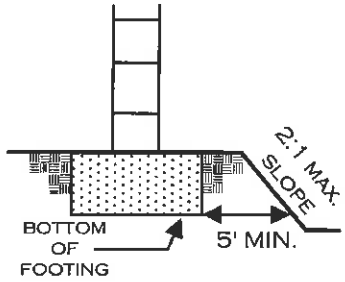

WALL SCHEDULE

MASONRY THICKNESS	6"	8"
VERTICAL REBAR SPACING	32" O.C.	40" O.C.